


STATE OF COLORADO

Examining Board of Plumbers

MOBILE HOME HOMEOWNER INSTRUCTIONS

For minimum plumbing standards, refer to the 2000 Uniform Plumbing Code Book

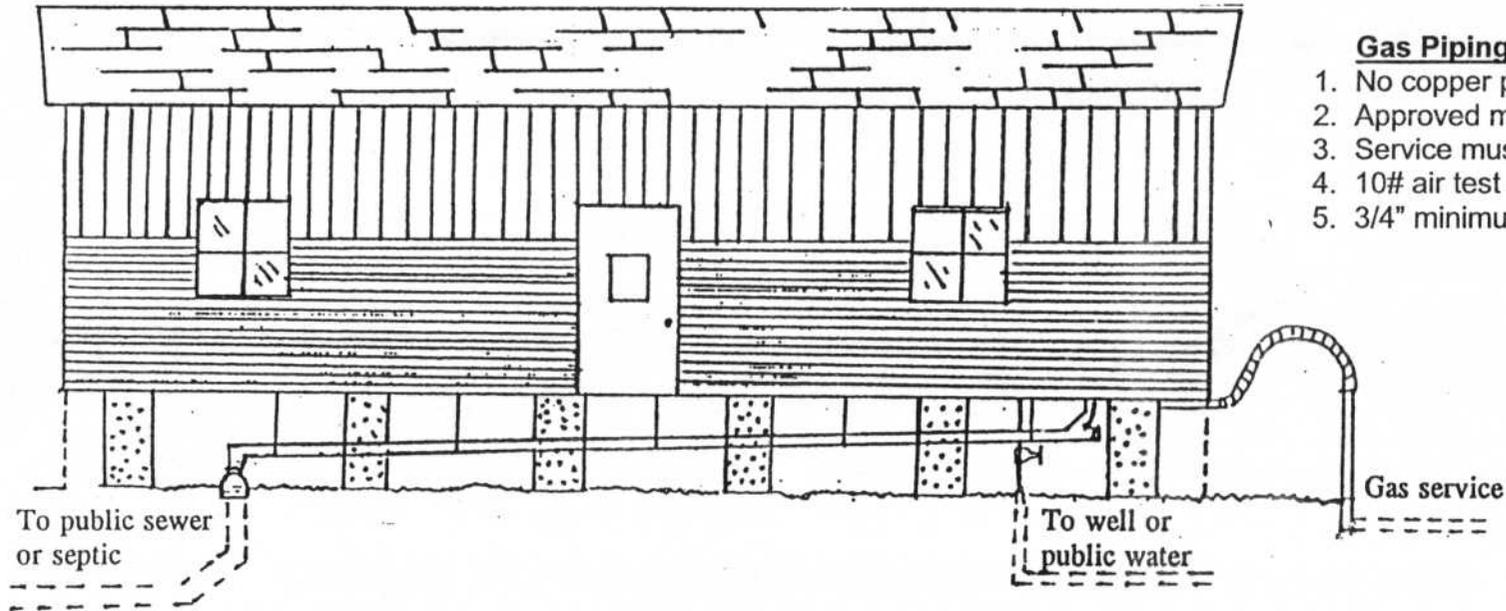

Gas Piping

1. No copper piping in system
2. Approved mobile home flex connector only
3. Service must penetrate outside mobil home
4. 10# air test on gas lines must be witnessed
5. 3/4" minimum gas service


Waste Pipes

1. Schedule 40 ABS or PVC
2. No mixing of ABS & PVC (black & white)
3. Minimum fall 1/4" per foot
4. Minimum strapping or blocking every 4'
5. Connection to sewer with approved rubber adaptor
6. Clean-out at upper terminal

Water Pipes

1. CPVC*, PEX or Copper under mobile home
2. 3/4" service (may be 5/8" OD in trailer park)
3. Shut-off under mobile home
4. Any hose bibb must have a vacuum breaker

*use either orange or Flow Guard 1 Step glue

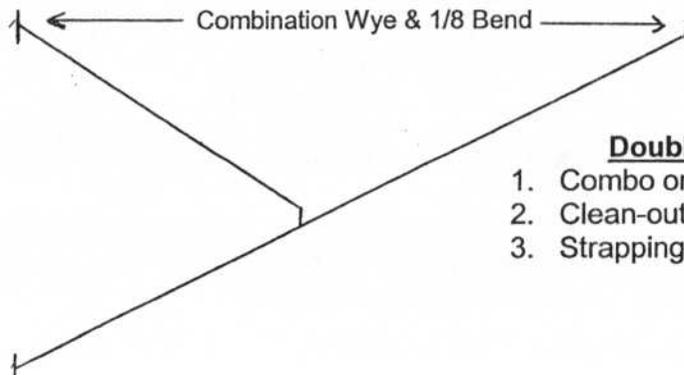

Double Wide Waste Piping

1. Combo only on horizontal to horizontal and vertical to horizontal directional changes
2. Clean-out at each branch over 5' in length in addition to clean-out at upper terminal
3. Strapping or blocking every 4'